IRRIGATION WATER LEGEND

PROPOSED		EXISTING
IRR	IRRIGATION WATER MAIN	IRR
6V	VALVE (TYPE) 6V=GATE VALVE BV=BUTTERFLY VALVE PV=PLUG VALVE CV=CHECK VALVE	6V
4"x3"	REDUCER (SIZE)	4"x3"
	CAP	
	BLOW-OFF VALVE	
	SINGLE SERVICE	
	DOUBLE SERVICE	
	TEE	
45°	BEND (ANGLE)	45°
	FIRE HYDRANT ASSEMBLY	

NOTES:

1. IF ADJACENT SYSTEMS ARE EXISTING, REMOVE PLUGS & CONNECT.
2. IF ADJACENT SYSTEMS ARE NOT EXISTING, PLACE A GATE VALVE, A MIN. OF 40' OF PIPE AND A PLUG BEYOND THE LAST SERVICE BEING CONSTRUCTED.
3. ALL FIRE HYDRANTS TO BE A MINIMUM OF 4' AND A MAXIMUM OF 6' BEHIND THE BACK OF CURB.
4. SEE SHEET 5 FOR POTABLE WATER & NON-POTABLE WATER SEPARATION NOTES.

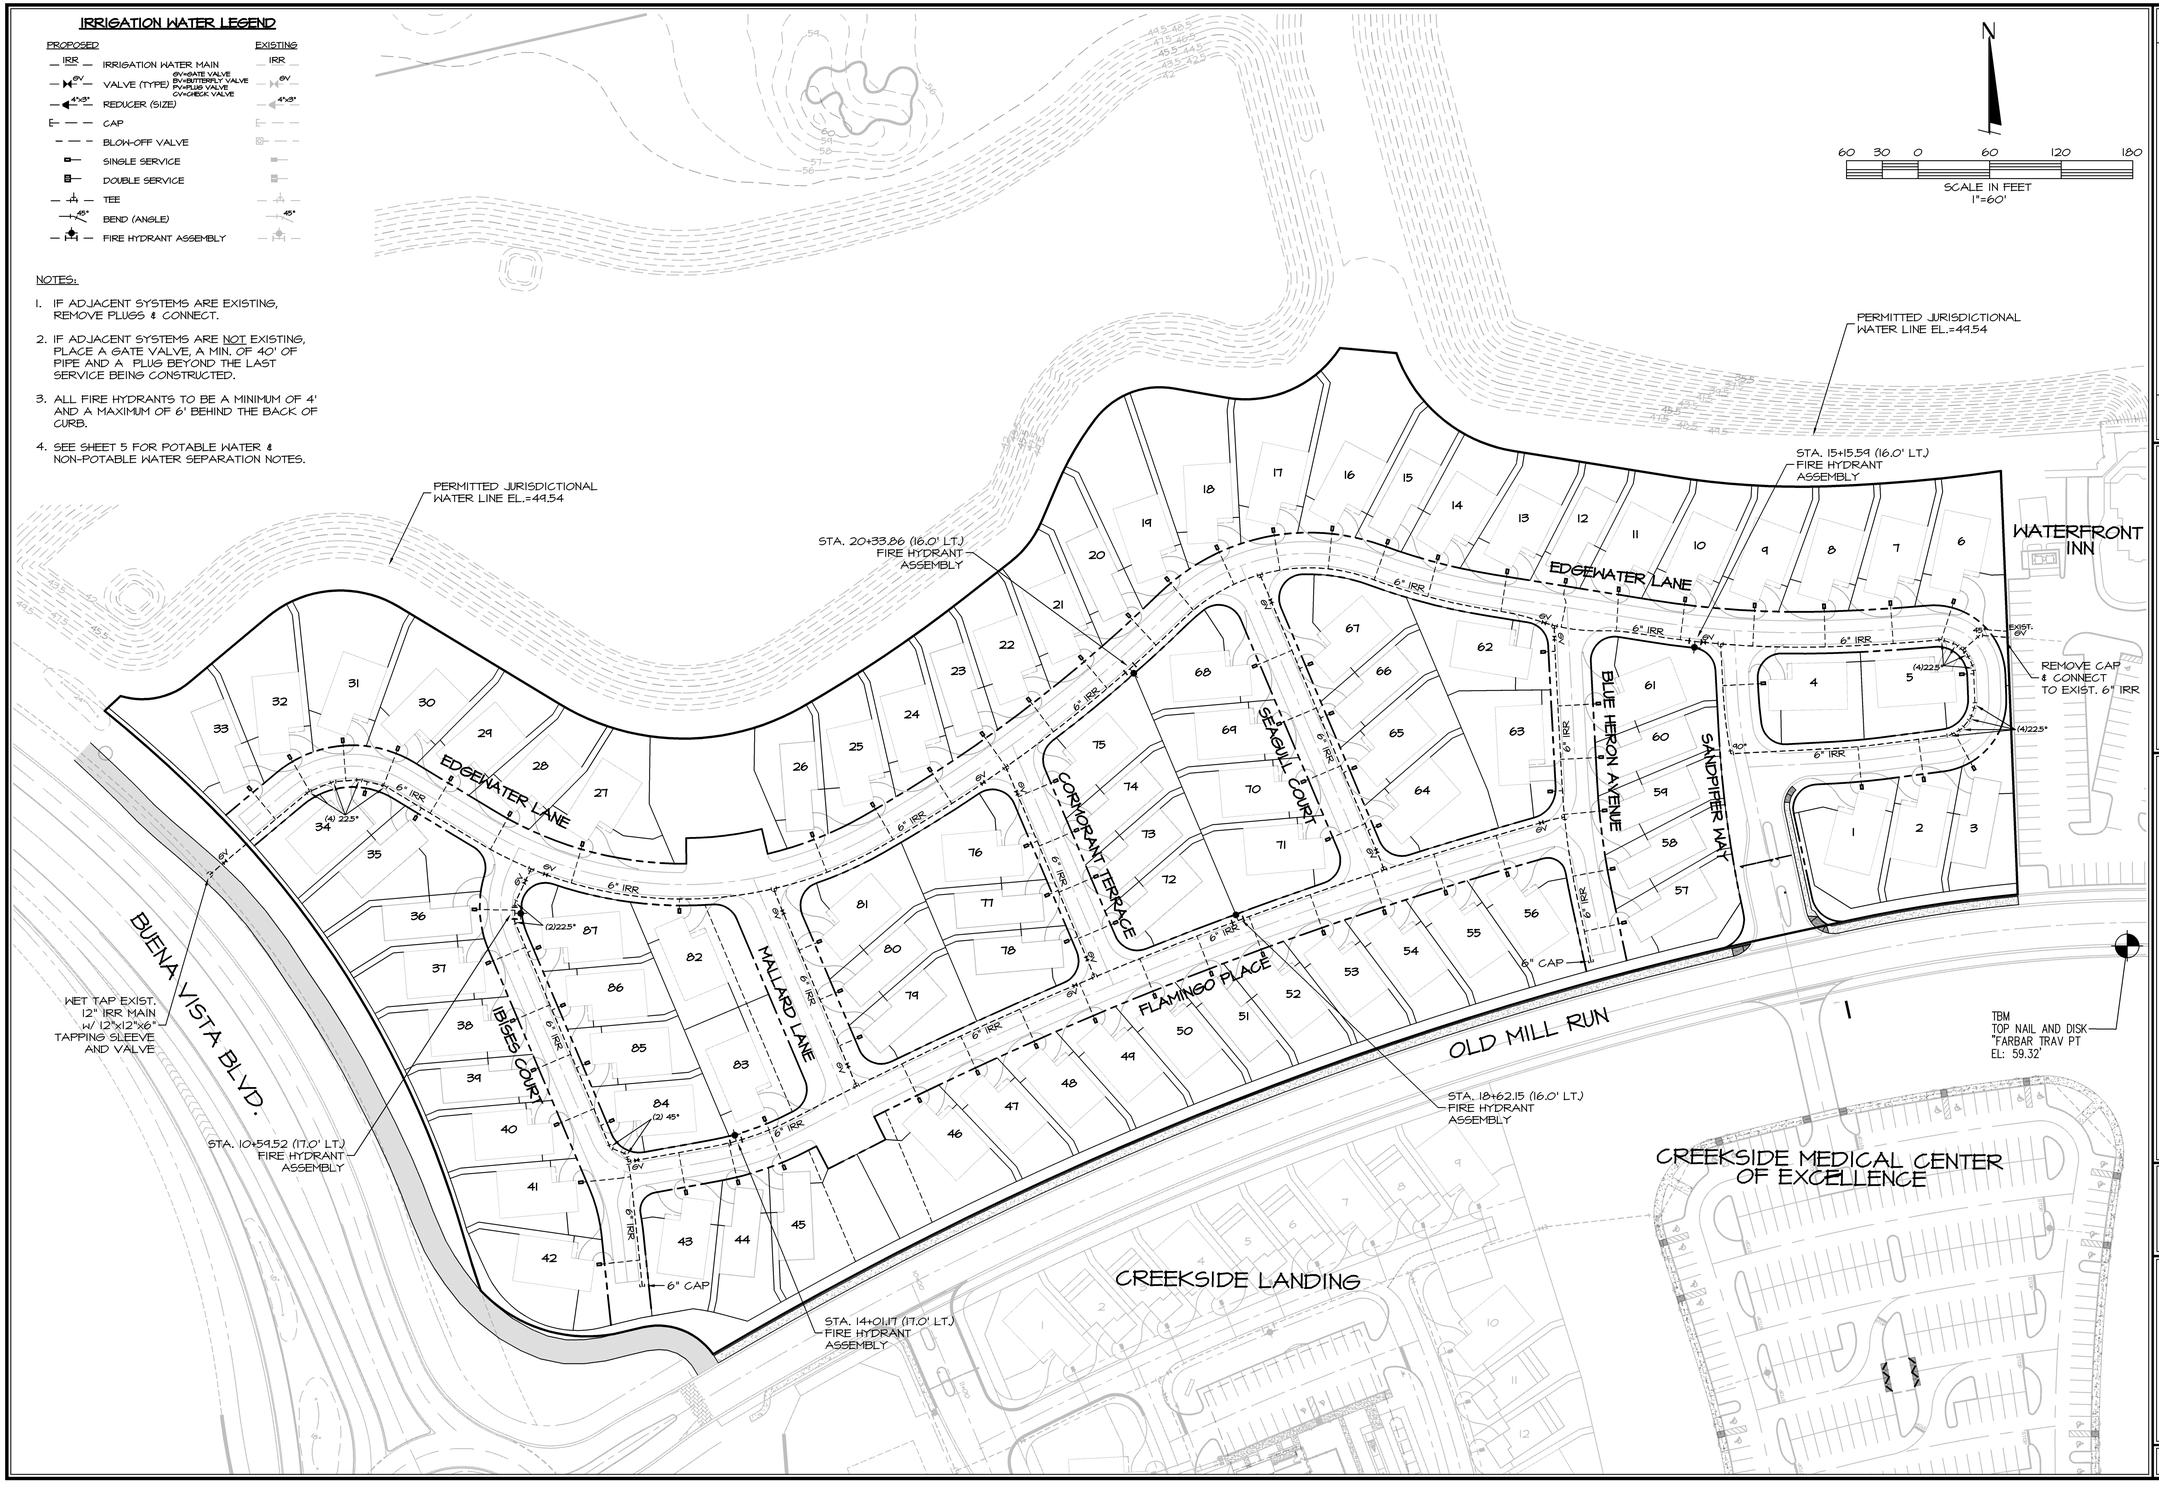

DATE	REVISIONS	BY

FARNER BARLEY ▲ ENGINEERS ▲ SURVEYORS ▲ PLANNERS AND ASSOCIATES, INC.
Certificate of Authorization Number: 4709
4450 N.E. 83rd Road ○ Wildwood, Florida 34785 ○ (352) 748-3128

The Villages Sumter County

VILLAGES OF SUMTER
EDGEWATER COTTAGES

IRRIGATION DISTRIBUTION MASTER PLAN

DATE 1-18-10
DRAWN BY DC
CHKD BY JAH
FILE NAME EDGEWATER IRR
JOB NO. 921141.1874

SHT. 7 OF 17

S:\SUMTER\UNITS&VILLAS\EDGEWATER COTTAGES\CIVIL\CONSTRUCTION\007-EDGEWATER-IRR.dwg, 3/29/2010 3:25:20 PM